NOTES:

1) MAXIMUM DISTANCE BETWEEN BOTTOM OF SLEEPER & TANK FLOOR IS 1/2". ADD ADDITIONAL SLEEPERS IF REQUIRED.

2) TOP, BOTTOM & FACE OF VAULT ARE 1/2" M.S., WALL IS 1/4" M.S. & DOOR IS 12GA. H.R.

3) THIS DIMENSION IS ALWAYS THE WIDTH OF THE MANWAY FLANGE PLUS 1 1/2".

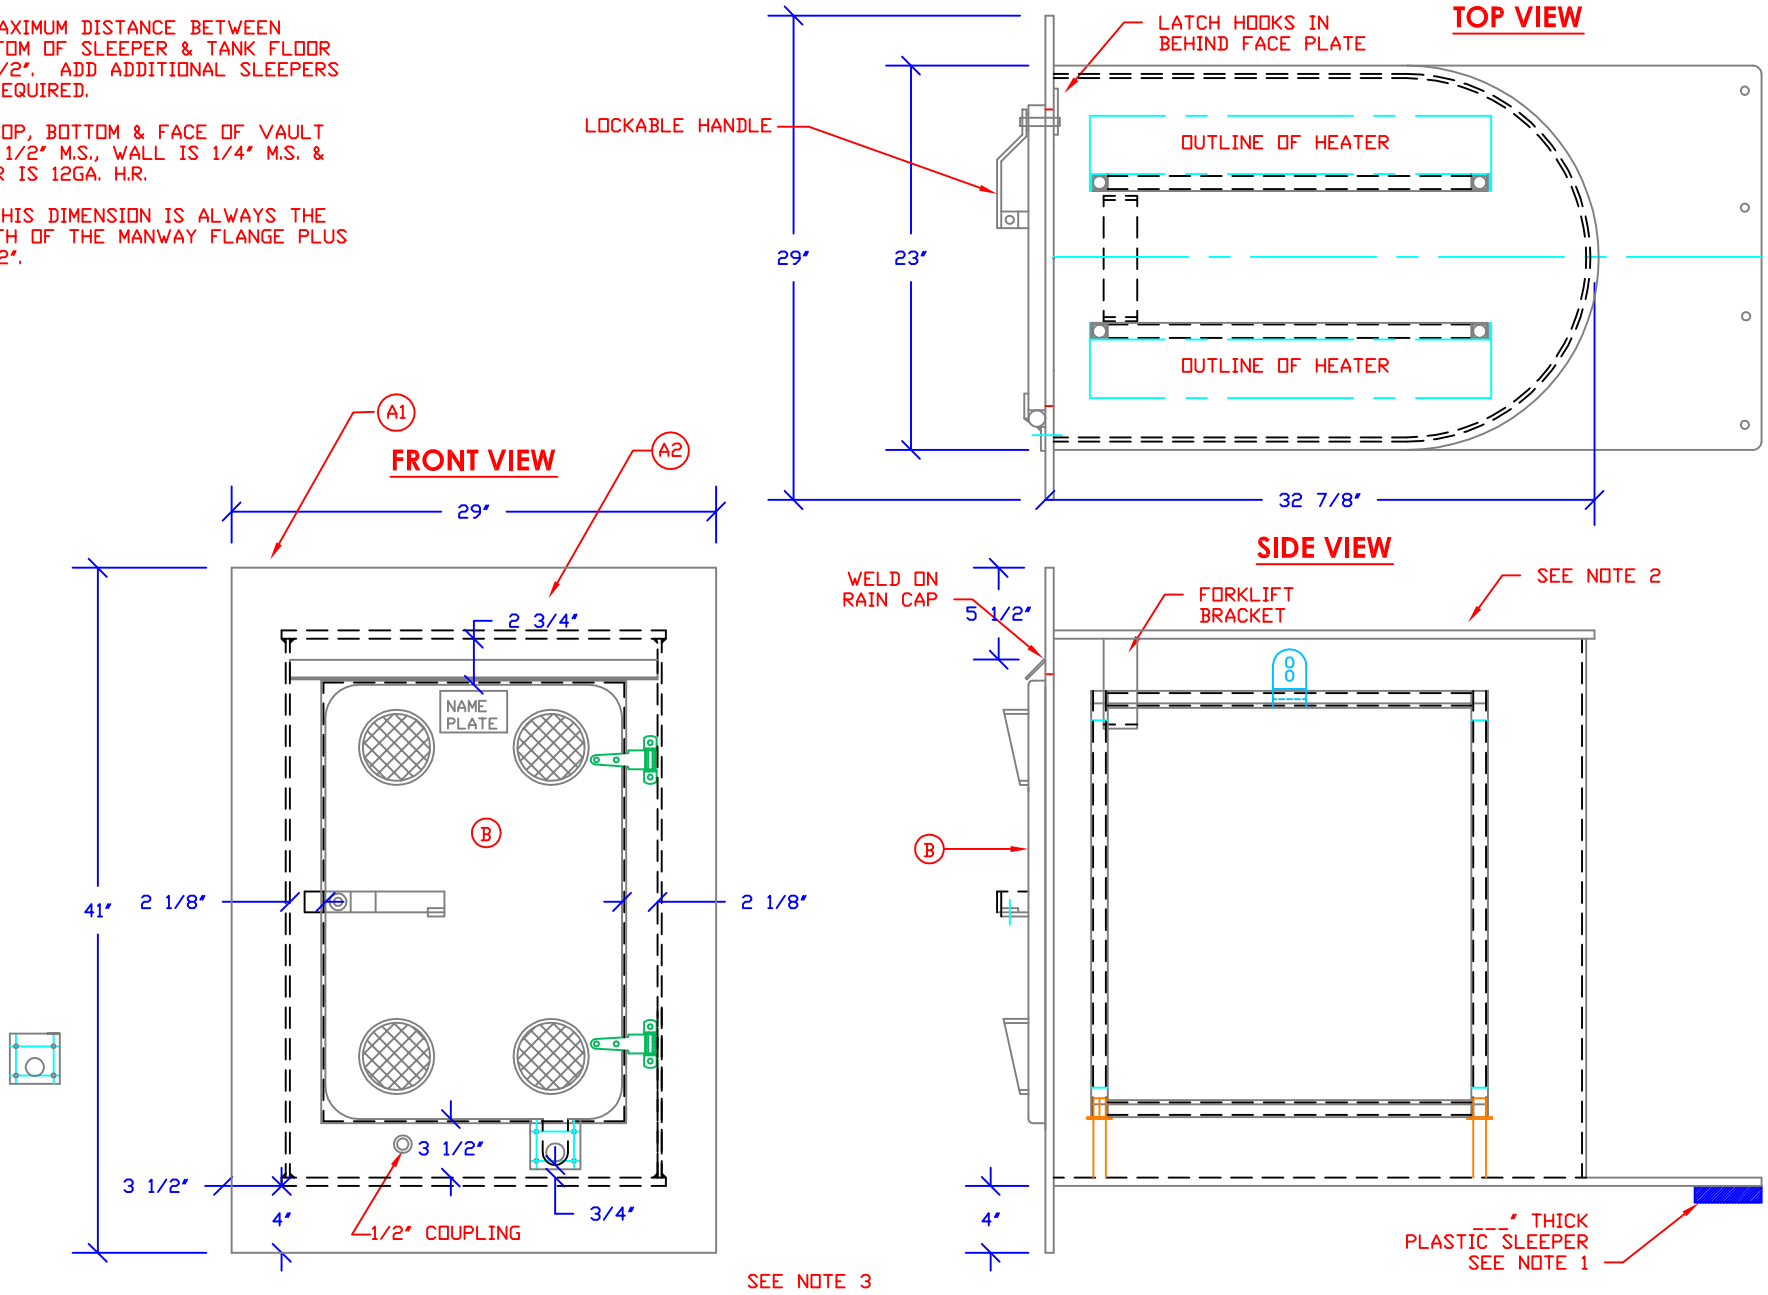

MATERIAL LIST

ITEM	QTY.		ITEM	QTY.	
A			E		
B			F		
C			G		
D			H		

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION AND IT SHALL NOT BE USED OR REPRODUCED OR ITS CONTENTS DISCLOSED, IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF G.T. METAL PRODUCTS LTD.

REV.	BY:	DATE	DESCRIPTION

GT METAL PRODUCTS

CUSTOMER: ENVIRO VAULT

PART/# EV2W-3H-DUAL HEATERS

DRAWN BY: B.WAGEMAKERS | DATE: APR 3/06

CHECKED BY: DRAWING#: EV2Wx3H -COMPLETE